



PM Series Power Meter

Quick Setup Guide - PMC-1000, PMC-1001, PMM-1000, PMB-1960

Safety Information

DANGER!

HAZARD OF ELECTRIC SHOCK, EXPLOSION, OR ARC FLASH

Follow safe electrical work practices. See NFPA 70E in the USA, or applicable local codes.

This equipment must only be installed and serviced by qualified electrical personnel.

Read, understand and follow the instructions before installing this product.

Turn off all power supplying equipment before working on or inside the equipment.

Any covers that may be displaced during the installation must be reinstalled before powering the unit.

Use a properly rated voltage sensing device to confirm power is off.

DO NOT DEPEND ON THIS PRODUCT FOR VOLTAGE INDICATION

Failure to follow these instructions will result in death or serious injury.

NOTICE

This product is not intended for life or safety applications.

Do not install this product in hazardous or classified locations.

The installer is responsible for conformance to all applicable codes.

Mount this product inside a suitable fire and electrical enclosure.

CAUTION

RISK OF EQUIPMENT DAMAGE

This product is designed only for use with 0.33V output current transducers (CTs).

DO NOT USE CURRENT OUTPUT (e.g. 5A) CTs ON THIS PRODUCT.

Failure to follow these instructions can result in overheating and permanent equipment damage.

For use in a Pollution Degree 2 or better environment only. A Pollution Degree 2 environment must control conductive pollution and the possibility of condensation or high humidity. Consider the enclosure, the correct use of ventilation, thermal properties of the equipment, and the relationship with the environment. Installation category: CAT II or CAT III

Provide a disconnect device to disconnect the meter from the supply source. Place this device in close proximity to the equipment and within easy reach of the operator, and mark it as the disconnecting device. The disconnecting device shall meet the relevant requirements of IEC 60947-1 and IEC 60947-3 and shall be suitable for the application. Disconnecting fuse holders can be used in the USA and Canada. Provide overcurrent protection and disconnecting device for supply conductors with approved current limiting devices suitable for protecting the wiring.

If the equipment is used in a manner not specified by the manufacturer, the protection provided by the device may be impaired.



This symbol indicates an electrical shock hazard exists.



Documentation must be consulted where this symbol is used on the product.



Equipment Maintenance and Service

WARNING! This equipment must only be installed by qualified electrical personnel. This product contains no user serviceable parts. Do not open, alter or disassemble this product. All repairs and servicing must be performed by Raritan authorized service personnel. Failure to comply with this warning may result in electric shock, personal injury and death.

Raritan

400 Cottontail Lane

Somerset, NJ 08873

USA

Product Overview

Raritan PM series power meters is a modular power metering solution comprising three components.


PMM: a 3-phase power meter with neutral and earth current monitoring.


PMB: a 96 channel branch circuit monitor that plugs into PMM. A PMM+PMB monitors a panel board mains and branch circuit.


PMC: power meter controller. One PMC controls up to 70 PMM or 8 PMM+PMB. Interconnection uses standard shielded CAT-5 cable. All modules receive redundant power and continue to function as long as one or more PMM remain powered.

Raritan PM series power meters are designed for ease of use:

- CTs are available in various ratings and contain built-in burden resistors so they can be snapped onto live wires without damage.
- CT orientation is not critical because meter auto-corrects polarity for any CT installed backwards.
- CT connections are made close to branch circuits using multi-conductor wiring harnesses with individual CT wire-pairs labeled and terminated with a keyed connector.









Product Specification

Voltage Measurement Inputs:

Input Range* 90-277VLN, 156-480VLL

Phase to Ground* 277V

Measurement Category CAT III, Pollution Level 2

Frequency 47-63 Hz Input Impedance $10\text{M}\Omega$

*Ratings for models with field wiring terminals. For models with factory installed line-cords, rating is limited by plug and ratings are labeled on back on unit.

Current Measurement Inputs:

Input Range 0-400mV

Input Impedance 10k

CT Type Voltage Output = 333mV at rated current

CT Rated Current 1-1200A

Meter Measurement Accuracy:

Active Power & Energy 0.5%: IEC 62053 Class .5, EN 50470-3

Class C

Reactive Power &

Energy

2%

RMS Voltage & Current 0.2% Frequency 0.1%

Sample Rate 64x AC frequency (phase locked)

Measurement Update 3 seconds: IEC 61000-4-30 Class S

Rate

Power Requirements:

Voltage 90-240V

Current 0.2A

Overvoltage Category CAT III, Pollution Level 2

Frequency 47-63 Hz

Mechanical:

Terminal Block Screw

Torque

0.37 ft-lb (0.5Nm) to 0.44 ft-lb (0.6Nm)



Terminal Block Wire

14-24AWG (.5-1.6mm)

Size

Terminal Wire

> 75 degree C

Temperature Rating DIN Rail

T35 (35mm)

Environmental:

Operating Temperature 0-60°C

Operating Humidity 5-85%RH
Operating Elevation 0-3000m

Conformance:

Safety UL/EN 61010-1

EMC/EMI EN61326-1, FCC Part 15 Class A

Power Meter (PMM) Connectors and Controls

A Voltage measurement.

B Power

c Factory use (do not connect)

D Meter Bus Terminator Switch.


Meter Bus Connectors. Connects PMM to controller.

F Expansion port. Connects PMM to PMB.

G Factory use (do not connect)

H Multi-conductor cable CT ABCDE connector.

(I) Meter ID configuration switch.






Power Meter Branch Monitor (PMB) Connectors

1	\mathbf{A}	Evnansion nort	Connects PMB to PMC
1	Ω,	, Εχραποιοπ port.	CONTINUES FINID TO FINIC.

- 1 Multi-conductor cable CT 1 connector.
- (2) Multi-conductor cable CT 2 connector.
- Multi-conductor cable CT 3 connector.
- (4) Multi-conductor cable CT 4 connector.
- (5) Multi-conductor cable CT 5 connector.
- Multi-conductor cable CT 6 connector.
- (7) Multi-conductor cable CT 7 connector.
- Multi-conductor cable CT 8 connector.



Power Meter Controller (PMC)

(A)MODBUS RDU isolated RS-485

B Meter bus connector (to PMM)

(c) Meter bus terminator switch

 \bigcirc 10/100 base-t Ethernet.

 $\left(\mathbf{E}\right)$ Feature port (Raritan asset strip)

Sensor port (temperature, (\mathbf{F}) humidity, etc.)

 \bigcirc USB A & B (flash drives, WIFI,

serial port)


(H)RS-232 (terminal CLI, modem)

Pin-hole access reset button

LCD (meter readings, settings,

configuration)

Keypad



DIN Rail Mounting

 (A) 35mm DIN rail


(B) **PMM**

Cable supplied with PMB (do not substitute longer length

cable)

PMB


Modules snap into rail. Pull (E) white tab here to remove.

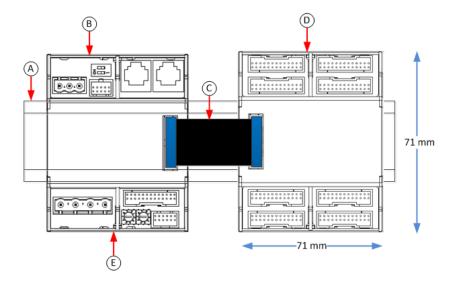




Voltage and Current Measurement Wiring

- Protect phase lines with fused disconnects rated for available short circuit current at connection point.
- All wiring: 14-22 AWG, 75°C, solid or stranded. Do not solder tin wire ends.
- All CT: 333mV output at rated current. Do not use current output CT. CTs can be connected to live circuits. Connect CT in either direction.

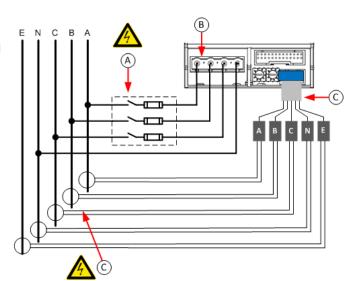

Circuit Type	Circuit Description	Wii	Wiring Connections							
		Vol	oltage			СТ	СТ			
		А	В	С	N	Α	В	С		
Single-Phase	L-N (120V,230V,240V)	Х			Χ	Х				
	L-L (208V, 400V)	Х	Х			Х				
Split-Phase	North American 120/240V Panel, 2L+N circuit	Х	Χ		Χ	Х	Χ			
Three-Phase	3L, 3-phase without neutral	Х	Х	Х		Х	Х	Χ		
	3L+N, 3-phase with neutral	Х	Х	Х	Х	Х	Х	Х		


PMB Branch Circuit Wiring

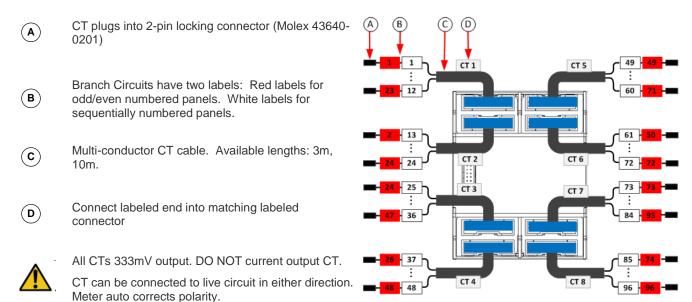


Branch Circuit	Description	Current Transformers			
		How Many	Connect To		
Line-Neutral (LN)	120V/230V circuit wired to 1-pole circuit breaker	1	phase line		
Line-Line (LL)	208/240/400V circuit wired to 2-pole circuit breaker	1	either phase line		
Line-Line-Neutral (LLN)	120V+208/240V circuit wired to 2-pole circuit breaker	2	each phase line		
Three-Phase (LLL, LLLN)	3-phase circuit wired to 3-pole circuit breaker	3	each phase line		

PMM Power Wiring

PMM can be powered from the voltage measurement inputs or from an auxiliary AC power source. Powering from the voltage measurement inputs minimizes circuitry, but the meter may stop functioning if the voltage turns off.

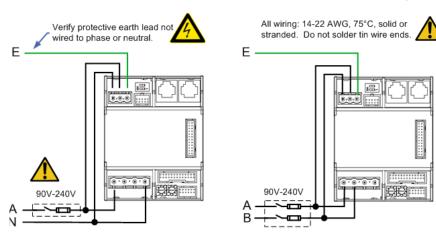


Powering from an auxiliary single phase circuit is required when the voltage measurement circuit exceeds 240V, or when continued operation is required if the voltage measurement inputs turn off.



Controller Wiring to Meters

Up to seventy 3-phase power meters (PMM) and eight branch circuit meters (PMM+PMB) are daisy-chain wired to a single controller (PMC) using shielded cat 5 Ethernet cable. The wiring order of the modules and controller is not important.

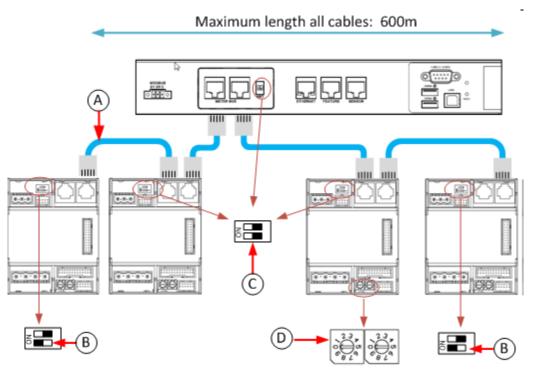


- All cables shielded Cat-5, each cable:100m max. length.
- Switch MBT (terminator) ON for devices at ends of daisy chain.
- © Switch MBT OFF for devices in middle of daisy chain.
- Assign each meter unique ID:

01-70: PMM without PMB 01-08: PMM with PMB



Panel Layout

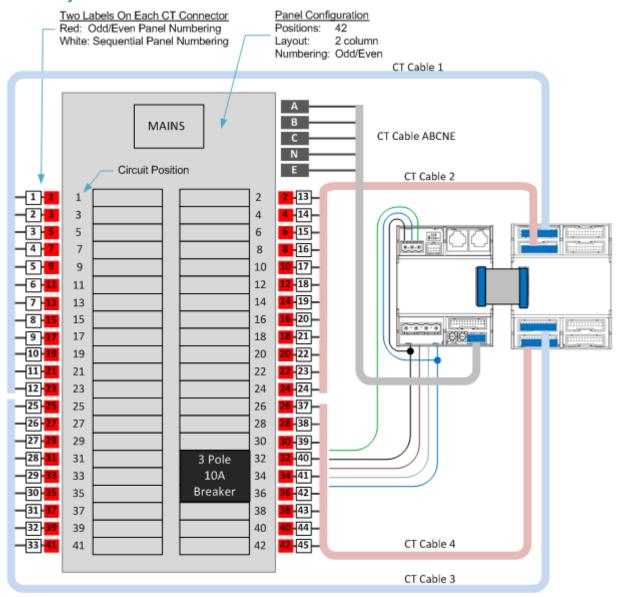

Login and Configuration

Connect your PC directly to the product to complete the initial configuration.

To access the web interface at the rack:

- 1. Disable the wireless interface of the PC.
- 2. Connect a cat 5 cable between the PC and the product network ports.
- 3. Open a browser. Enter the URL "https://pdu.local". The login page appears.

If the URL does not resolve, use the IP address of the PMC. Retrieve the direct IP address using the LCD display: Menu > Device Information, scroll to the IPV4 settings. Enter the IP address in the web browser: "https://IP address/"

- 4. Login with the default username and password. Allow 30 seconds for first connection.
 - Username: admin
 - Password: raritan



Configuring Power Meters and Branch Circuit Monitors

You can configure your product with a spreadsheet, or in the product's web interface.

To configure with a spreadsheet:

Go to Raritan.com and download the configuration spreadsheet from the BCM2 Support page. Follow the instructions in the spreadsheet.

To configure with the product web interface:

Make a network connection to the product. See *Connecting the Network Port* (on page 10). Follow the instructions in this guide, starting with *Configure Using the Web Interface* (on page 11).

Configure Using the Web Interface

Scan Power Meters

- (1) Go to the Dashboard.
- Click Scan Power Meters.

Click the power meter or panel in the discovered list.

Types:

Power Meter: 3-phase

Branch Circuit Monitor:

BCM

(4) Click Configure.





Configure Power Meter (PMM without PMB)

(1) Enter a name.

Select the circuit type:


- Single Phase Split Phase 3-phase
- (3) Enter the mains circuit breaker rating.

Select the checkbox for each CT installed.

- Enter the CT rating. Ratings are marked on the CT.
- (5) Click OK.

The configured power meter displays in the dashboard.

If there are more unconfigured power meters, the scan results stay open.

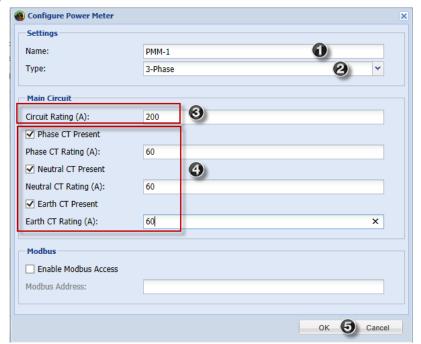

Configure Panel Mains Circuit

1 Enter a name.

Select the circuit type:

Single Phase Split Phase 3-phase

Enter the number of circuit positions in the panel.

Select the panel layout: one or two columns.

Select the circuit position numbering style: sequential or odd/even.


Enter the current rating (circuit breaker rating) of the circuit.

Select the checkbox for each CT installed.

Enter the CT rating. Ratings are marked on the CT.

(6) Click OK.

The configured branch circuit monitor displays in the dashboard .

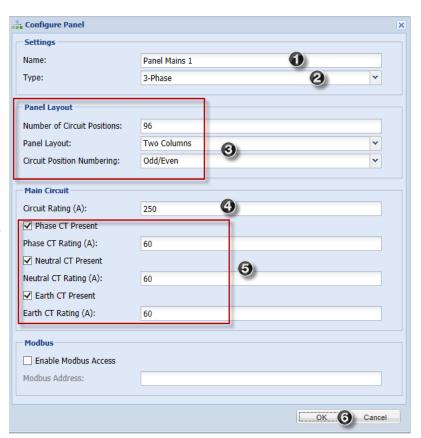





Configure Panel Branch Circuits

- In the dashboard, click the BCM to open the pop-up menu.
- Click Details. The Panel details open in a new tab.



- In the Panel Branch
 Circuits section, click the
 circuit position to open
 the pop-up menu.
- Click Create Circuit. The Create Circuit dialog opens.

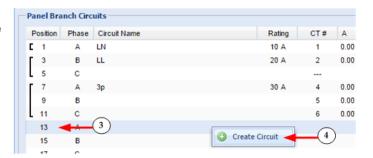

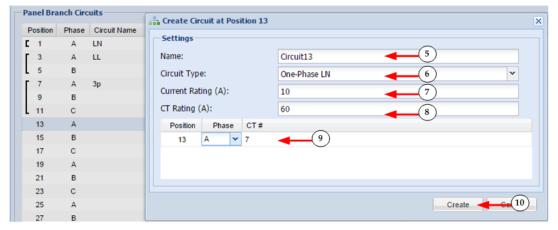

- (5) Enter a name for the circuit.
- 6 Select the circuit type: One-Phase LN, One-Phase LL, One-Phase LLN, or Three-Phase. Circuit type cannot be changed later.
- (7) Enter the current rating of the circuit in Amps.
- 8 Enter the rating of the CT connected at this circuit position in Amps.
- (9) Click the Phase or CT# to edit the automatic labels.
- (10) Click Create.

Circuits appear in the list with a black bracket around the circuit positions.




Configure Thresholds

- In the dashboard, click the power meter or panel to open the pop-up menu.
- Click Configure. A new dialog opens.
- Double-click the reading you want to set thresholds for. A new dialog opens on top.

Select the checkbox for the level, and enter the threshold current in amps. Click OK.


This example shows RMS
Current thresholds set for
upper warning and critical
levels for the circuit max
current rating, and a lower
warning set for 1 amp.



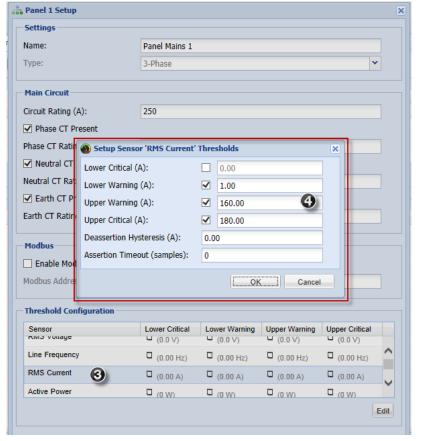



Thresholds display in the configuration dialog.



Using the PMM's Display

Automatic Mode:

The PMM has a display with automatic and manual modes. In automatic mode, the display scrolls through readings.

Manual Mode:

In manual mode, you can select readings and settings to view.

Press or to view the Main Menu.

To return to automatic mode, press once or several times.

Press to choose a menu item. Press to select.



Power Meter details

